



Wake effects above rated wind speed. - An overlooked contributor to high loads in wind farms

Larsen, Torben J.; Larsen, Gunner Chr.; Aagaard Madsen , Helge; Markilde Pedersen, Søren

Publication date:
2015

Document Version
Peer reviewed version

[Link back to DTU Orbit](#)

Citation (APA):

Larsen, T. J. (Author), Larsen, G. C. (Author), Aagaard Madsen , H. (Author), & Markilde Pedersen, S. (Author). (2015). Wake effects above rated wind speed. - An overlooked contributor to high loads in wind farms. Sound/Visual production (digital), European Wind Energy Association (EWEA).

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

Wake effects above rated wind speed.

-An overlooked contributor to high loads in wind farms

**Torben J. Larsen¹⁾, Gunner Larsen¹⁾, Helge A. Madsen¹⁾,
Søren M. Pedersen²⁾**



¹⁾ Technical University of Denmark

²⁾ Siemens Wind Power A/S

EWEA 2015

Paris, 17-20. Nov 2015

Principle of Dynamic Wake Meandering

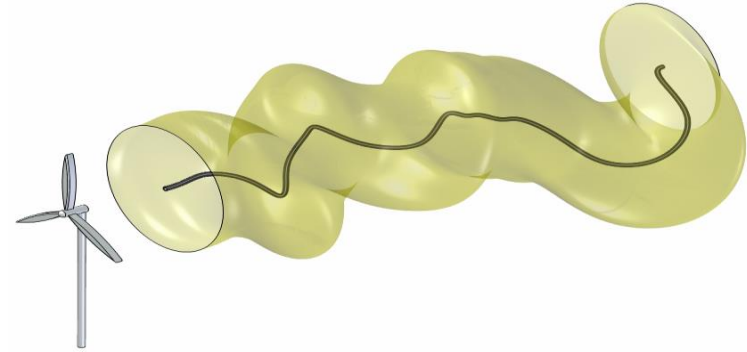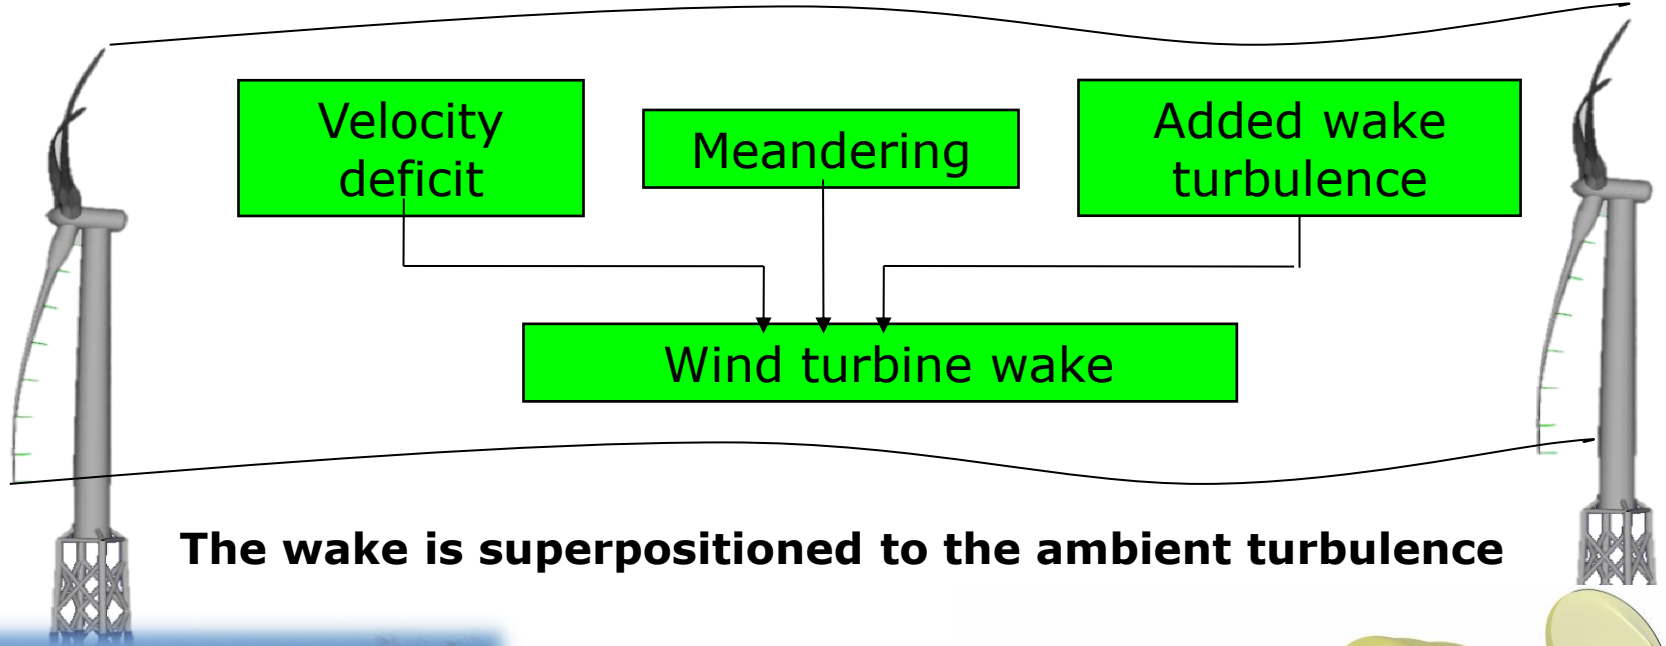


Multiple wake handling today

- Previous studies (Larsen, et. 2013, Madsen et al ???) indicated that a flow equilibrium seem to occur so the extracted energy equals the restoring flow from turbulent mixing)
- The power production of turbine n in a row is almost the same as for turbine 2.
- A MAX operator was recommended – well knowing that it is not a perfect approach.

Lillgrund Wind farm




- 48 SWT 2.3 MW prvs turbine
- Lowest spacing is 3.3D
- Turbine C-8 is fully instrumented with strain gauges. We have access to results for the blade bending moment and tower bottom bending moment
- The met mast data cannot be used

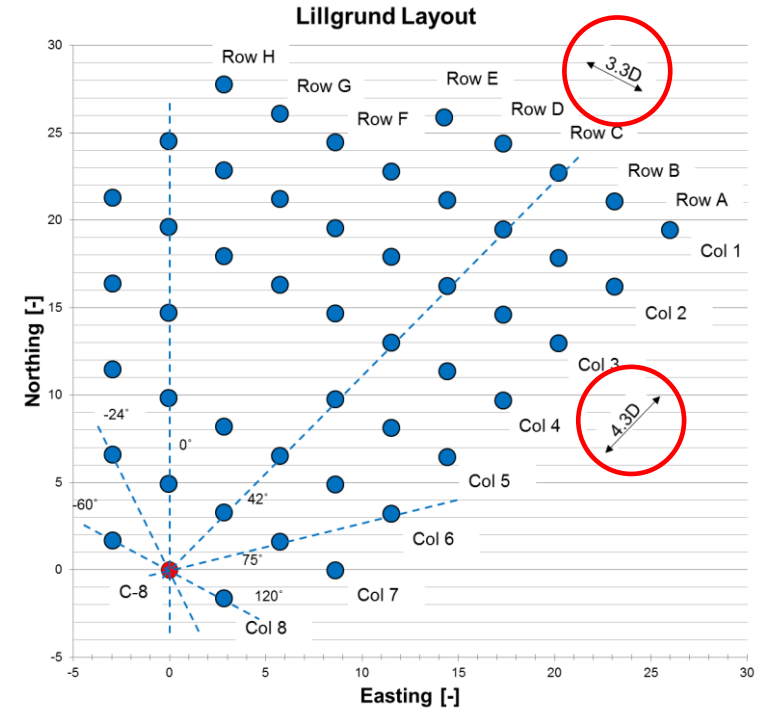

Lillgrund 8-10 m/s


Lillgrund measurement blade root flap $m=1$

8–10 m/s:

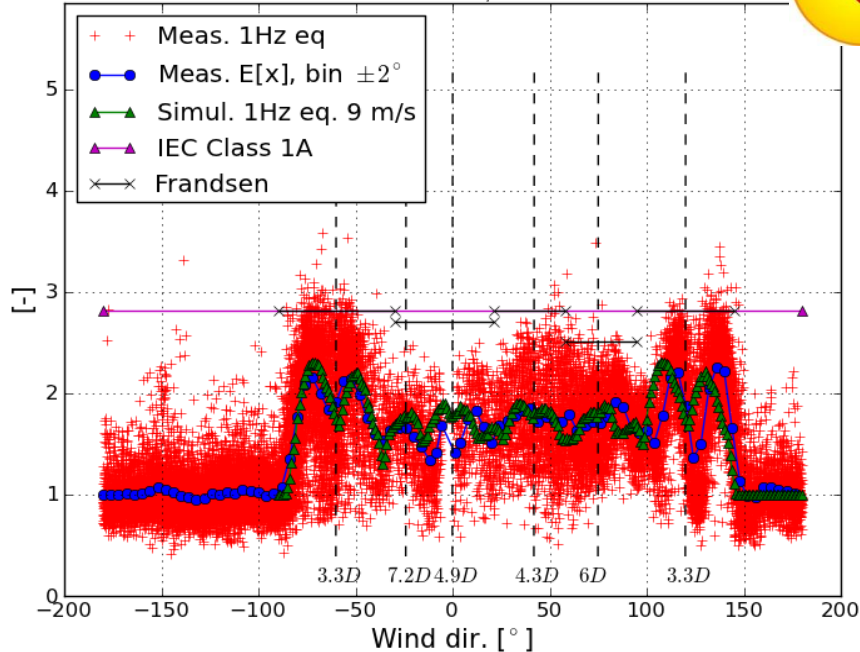

Lillgrund measurement tower bend. $m=5$

8–10 m/s:

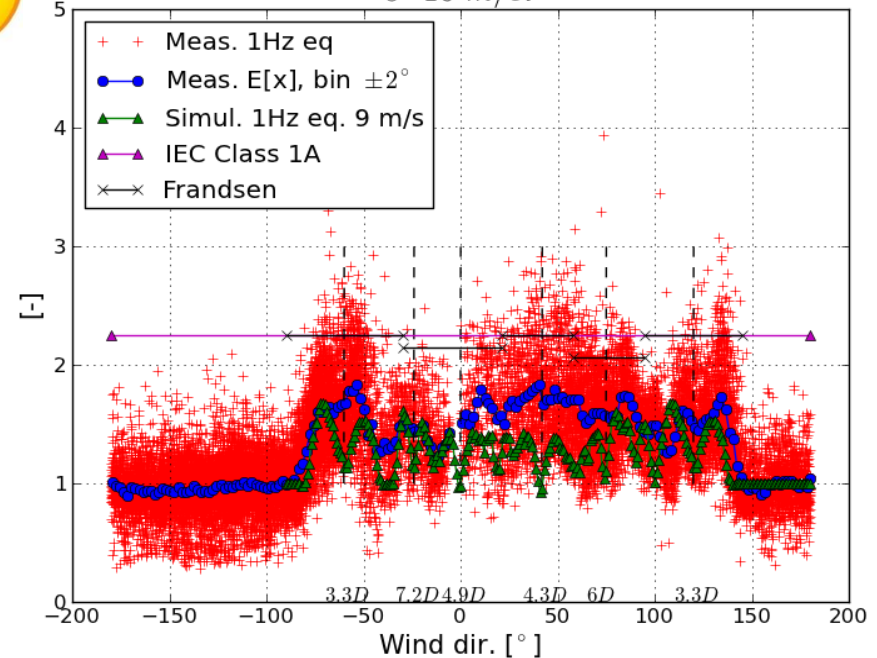


Results using MAX deficit operator

Lillgrund 10-12 m/s




Lillgrund measurement blade root flap $m=10$

10–12 m/s:

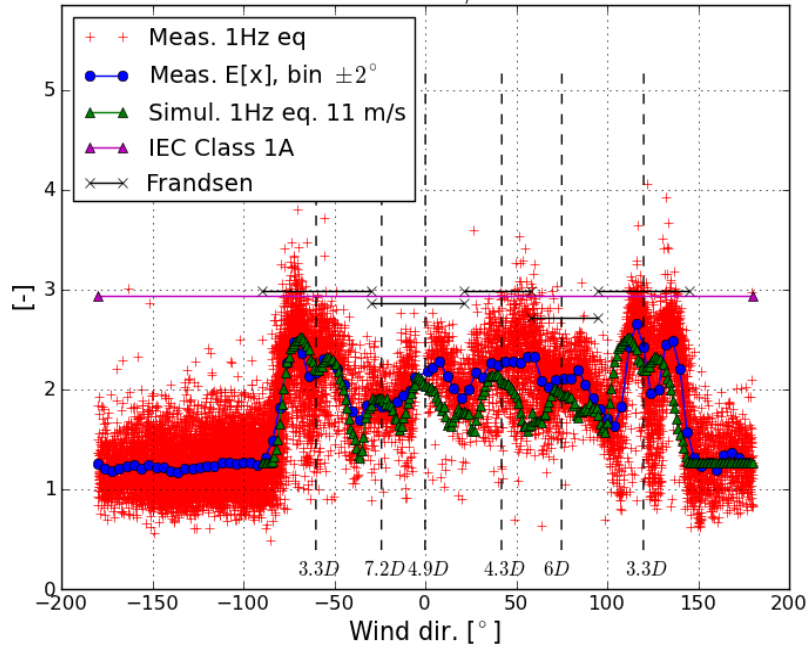

Lillgrund measurement tower bend. $m=5$

10–12 m/s:

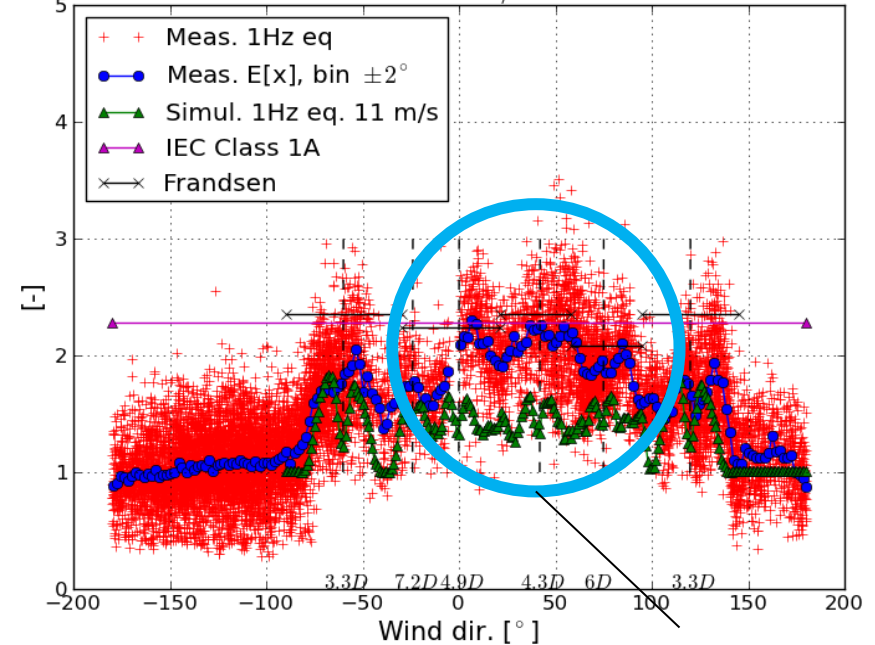


Results using MAX deficit operator




Lillgrund 12-14 m/s

Lillgrund measurement blade root flap $m=10$
12–14 m/s:

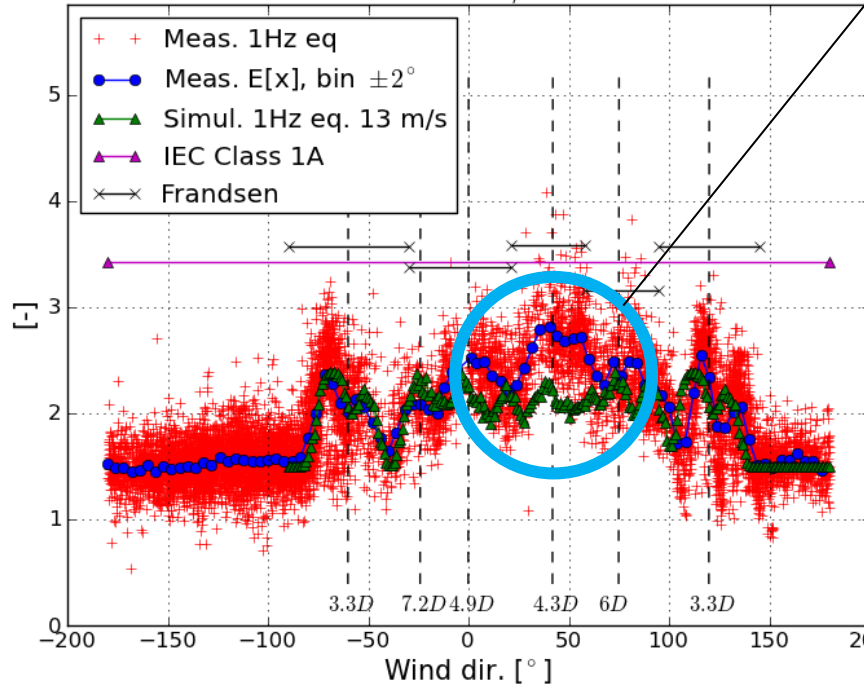

Lillgrund measurement tower bend. $m=5$
12–14 m/s:

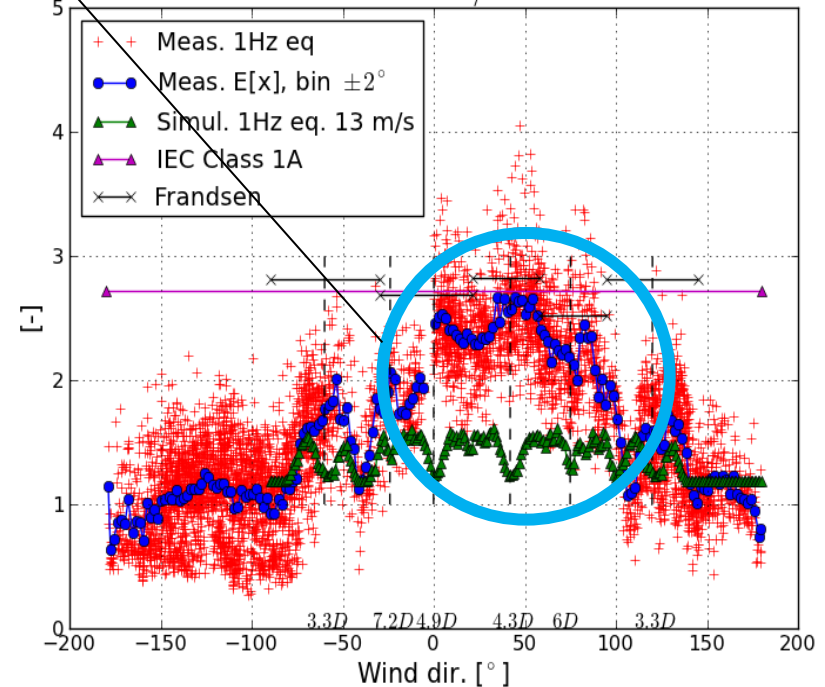


Results using MAX deficit operator


Lillgrund 14-16 m/s



Lillgrund measurement blade root flap $m=10$
14–16 m/s:

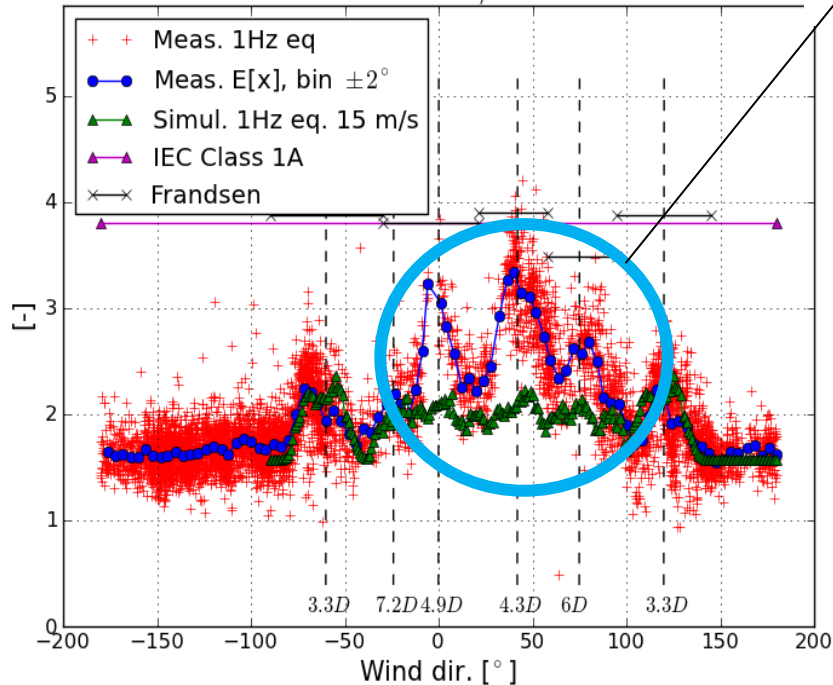


d measurement tower bend. $m=5$
14–16 m/s:

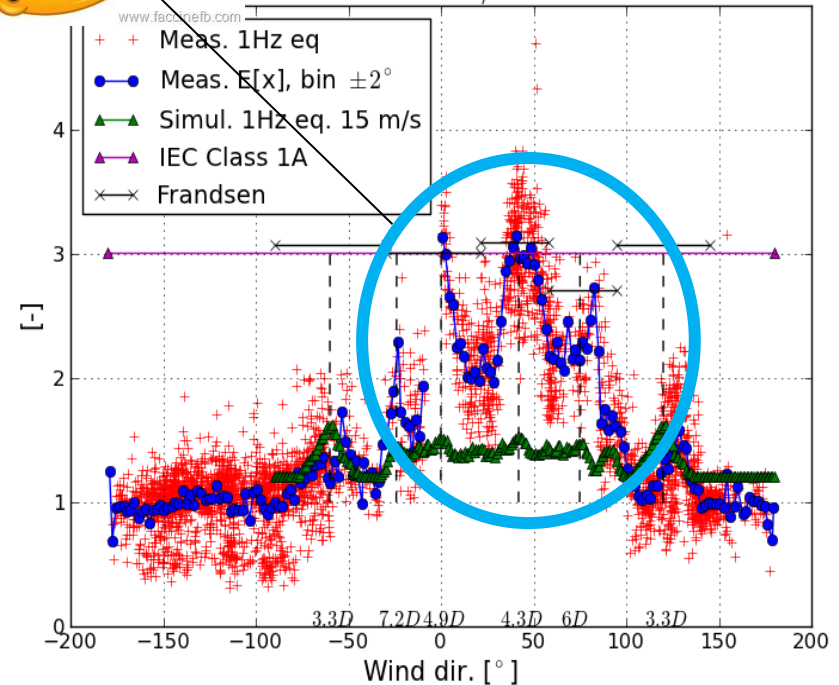


What happens at high wind speeds?

- The wind turbine thrust is significantly lower than at high wsp
- The turbulent mixing is reduced – as the vortex strenght and deficit depth is not as high as at low wsp
- The wake vortex system is in general more stable in low thrust situation.

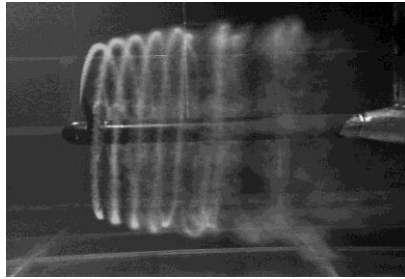

From R. Mikkelsen,
TSR=8

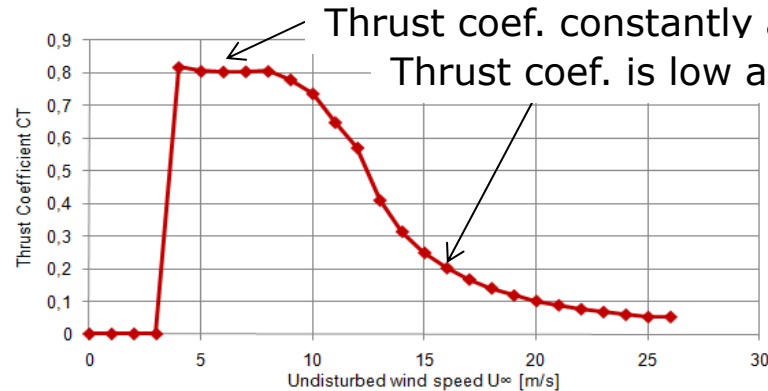


Nasa Ames experiment 2000,
low thrust

- So far no CFD simulations has been performed in multiple wake – high wsp situation as the main focus has been directed to power production

Results using linear superposition


Lillgrund measurement blade root flap $m=10$

Summation approach 12–14 m/s :

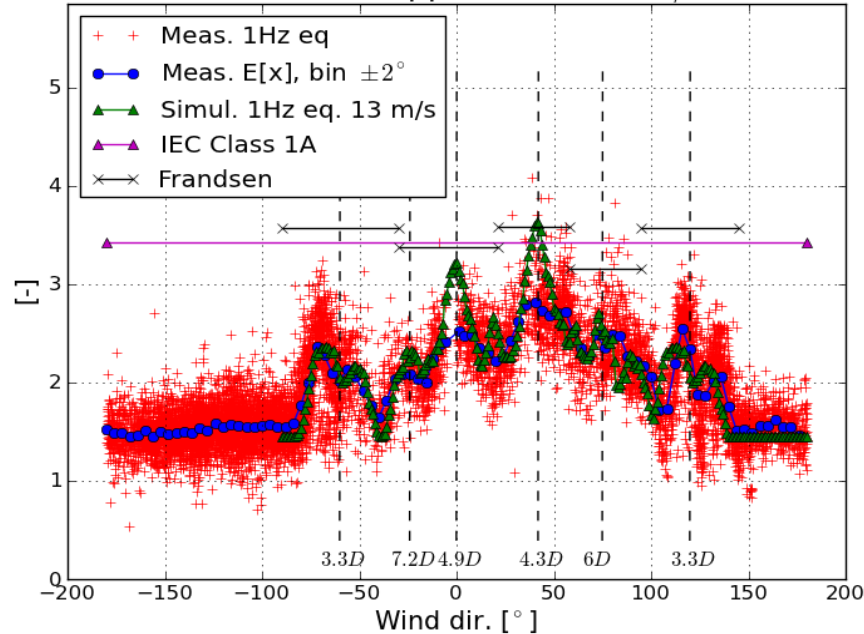


Lillgrund measurement tower bend. $m=5$

Summation approach 12–14 m/s :

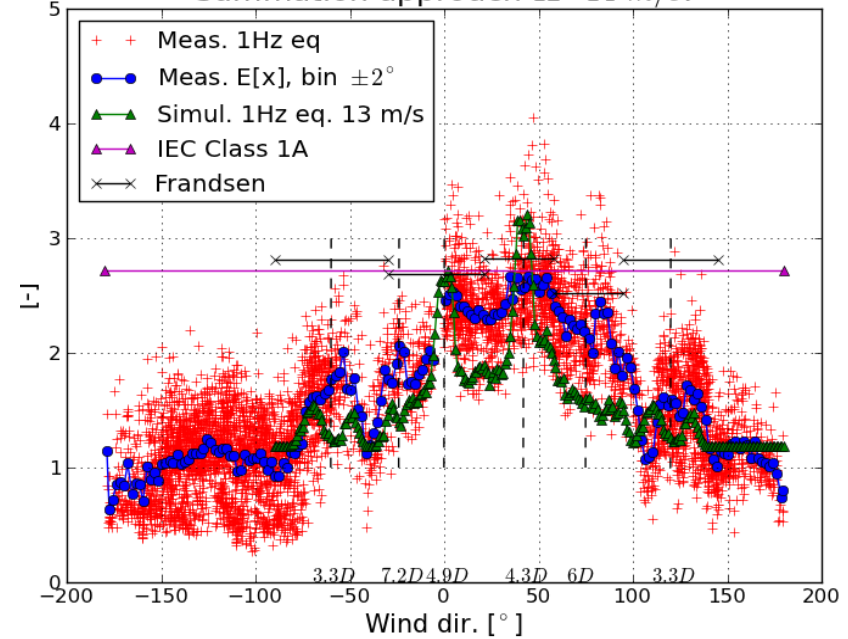


Results using linear superposition

Lillgrund measurement blade root flap $m=10$
Summation approach 14–16 m/s:

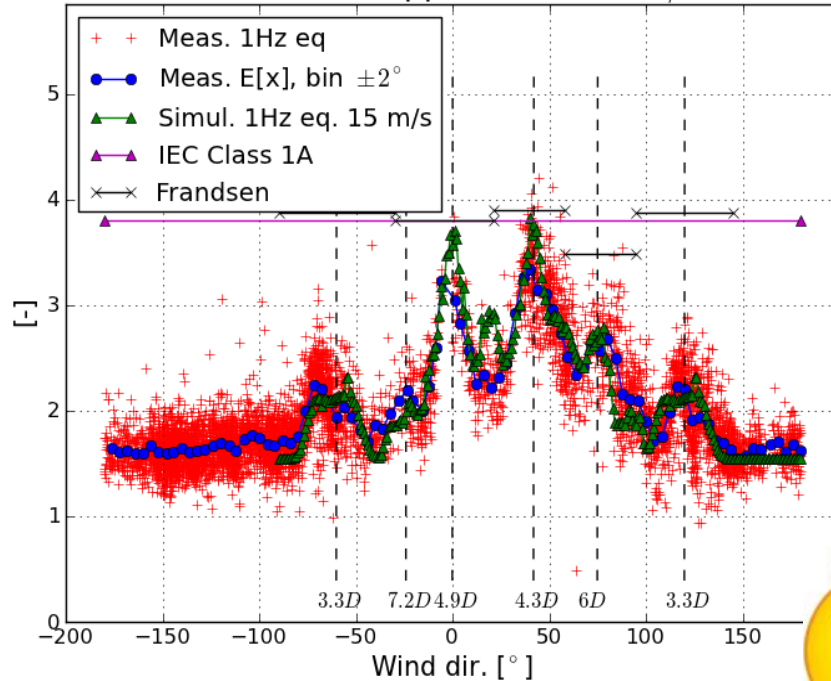

Lillgrund measurement tower bend. $m=5$
Summation approach 14–16 m/s:

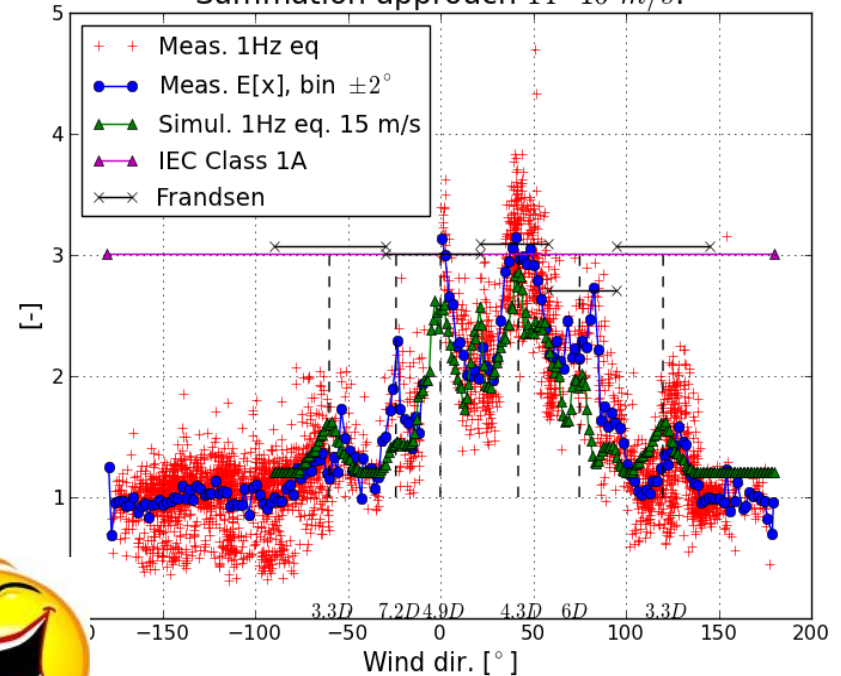

Conclusions

- In multiple wake situations
 - **Wake effects may cause significantly increased loads at high wind speeds, even though a wind turbine here is “aerodynamic transparent”**
 - DWM: A maximum deficit operator works well below rated power
 - DWM: A linear superposition works well above rated power

With this in mind:

The load levels in wind farms can be simulated highly accurate using the DWM approach!

- The Frandsen method is still conservative in most situations
 - And highly conservative in single wake with short spacings!
- The IEC class 1A is also still conservative in most situations
- The highest normal operation loads occurs at high wind speed situations. Even with DWM in complex wake conditions: *Increased ambient turbulence cause increased loads.*